


# 13.0 : EARTHING

Lampiran E50  
Pindaan Dec 2004

## DIMENSION OF MAIN EARTHING BAR (MEB) AND EARTHING CONDUCTORS FOR 50KA EARTH FAULT CURRENT FOR 1 SECOND DURATION

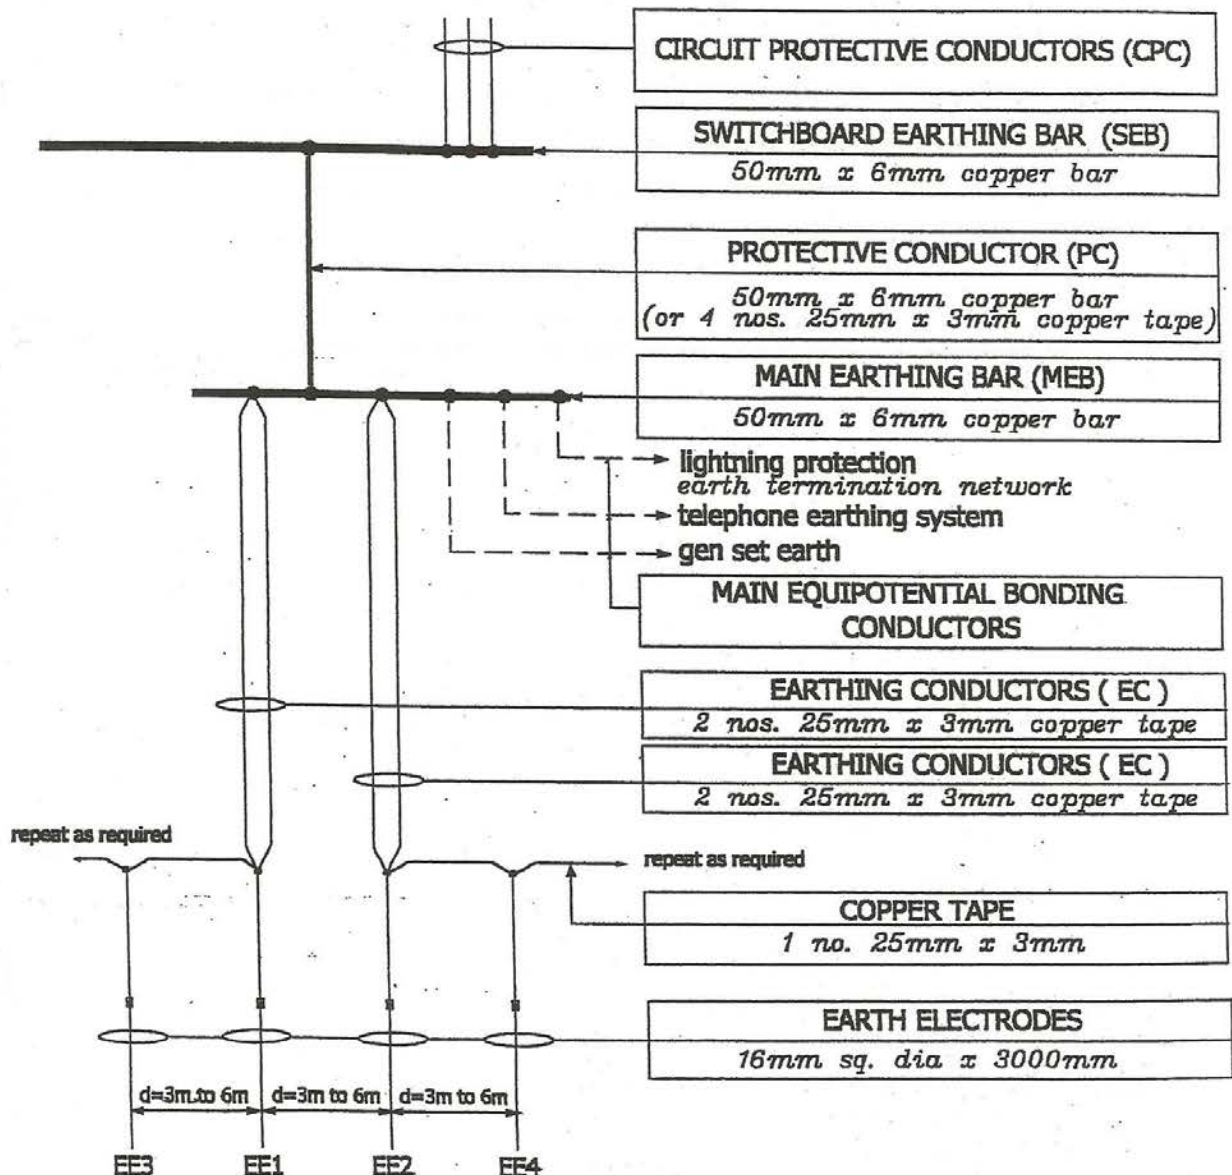

### NOTES :

1. Connection of the earthing conductors to the earth electrodes shall be by exothermic welded connections
2. Earth electrodes shall have pure copper uniformly molecularly bonded onto a high tensile steel core to a minimum of thickness of 0.25mm
3. EE1 - Earth electrode no. 1 from MEB
4. EE2 - Earth electrode no. 2 from MEB