

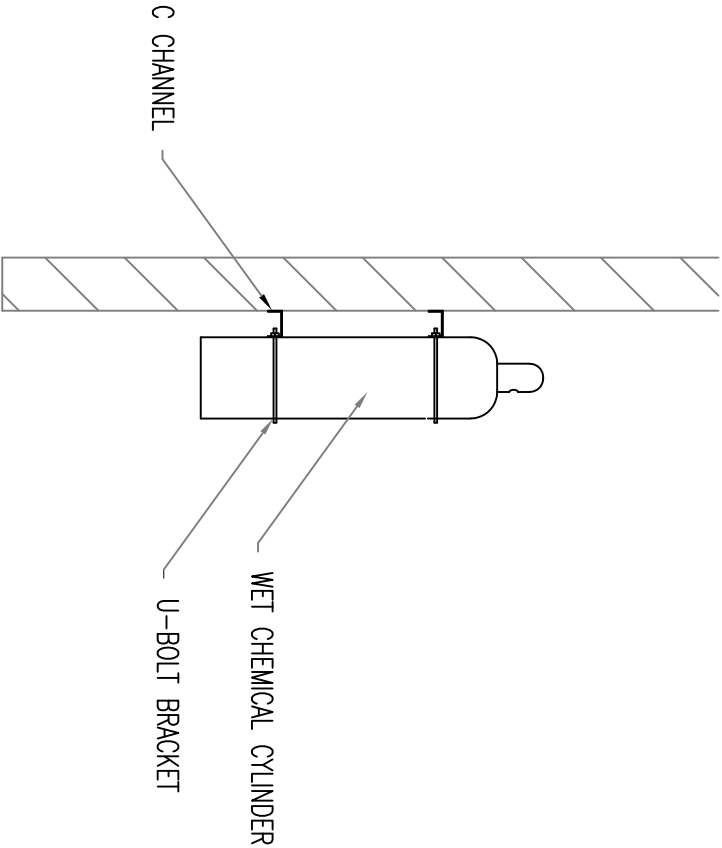



WET CHEMICAL NOZZLE

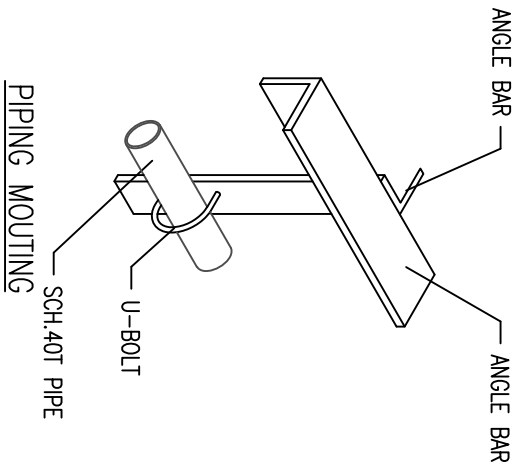


TYPICAL MOUNTING DETAIL – C CHANNEL BRACKET
FOR WET CHEMICAL CYL

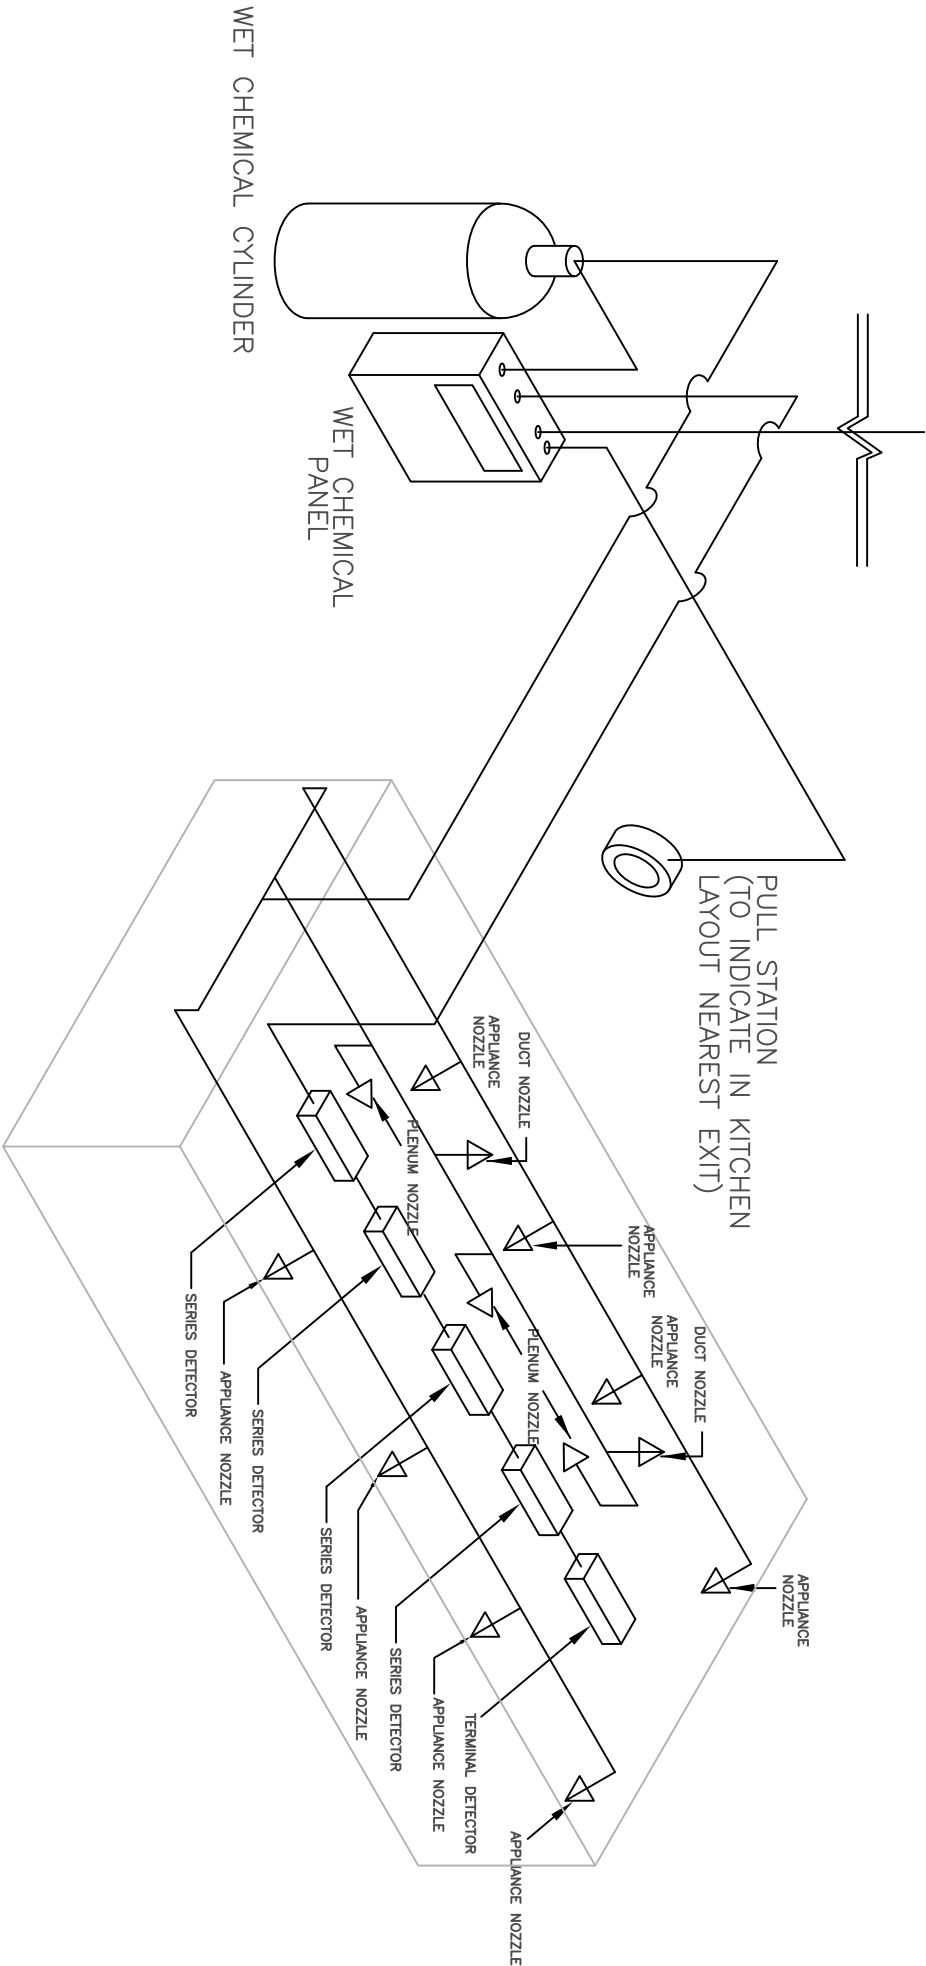

TYPICAL WET CHEMICAL SYSTEM

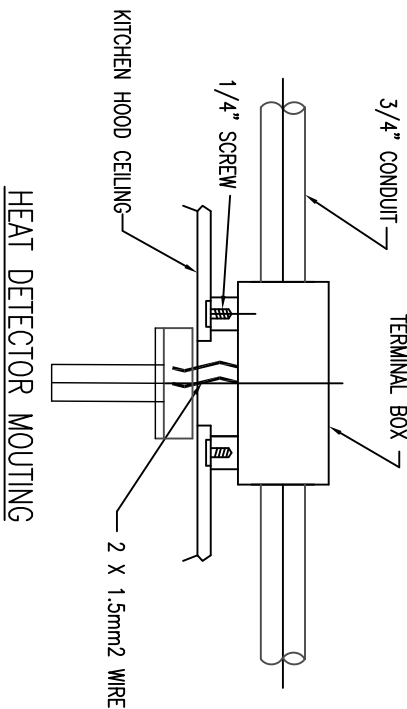

HEAT DETECTOR MOUNTING

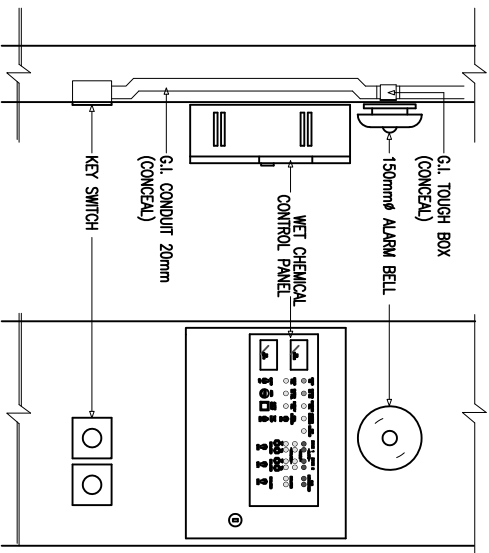

TYPICAL DETAIL INSTALLATION FOR
ALARM BELL & BREAKGLASS

NOTA PENENTUAN

1. THIS IS A TENDER DRAWING AND SHALL NOT BE TAKEN AS WORKING DRAWING
2. THE ARCHITECTOR IS RESPONSIBLE TO CHECK ALL DIMENSIONS ON SITE.
3. THE SUCCESSFUL TENDERER SHALL BE REQUIRED TO SUBMIT WORKING DRAWING OR APPROVAL BEFORE CARRYING OUT ANY WORK.
4. THE SUCCESSFUL TENDERER SHALL BE SURE THEIR WORK WITH SITE CONDITION
5. FOR OTHER NOTES, REFER TO SPECIFICATION



KERAJAAN MALAYSIA



JASA KEPADA RAKYAT
CAWANGAN KEJURUTERAAN MEKANIKAL
JABATAN KERJA RAYA MALAYSIA
Tingkat 2625, Dewan Kerajaan (Blok G)
Jalan Sultan Salahuddin
50480 Kuala Lumpur

CAWANGAN KEJURUTERAAN MEKANIKAL

DISAHKAN

PENGARAH KAWAN CAWANGAN KEJURUTERAAN MEKANIKAL

I/c. ZULKIFLI BIN ABDUL RASHAD

PENGARAH PENCERBUT KAWAN KEJURUTERAAN MEKANIKAL

I/c. SUHAILI BIN MANSOR

JURUTERA MEKANIKAL PENCUSA KAWAN

JURUTERA MEKANIKAL KAWAN

PROJEK:

PERKARA:

SISTEM PERALATAN DAPUR
& LPG

PERINCINAN SISTEM WET CHEMICAL

DRAWN:	DATE:
NTS	SEPT. 2021
CHECKED:	REVISOR:
BIL. LUKISAN:	

TENDER DRAWING